

Washington Hospital Center Pilot Briefing Guide

DC08 - N 38 55.731 / W 077 00.998

MedSTAR Communication Center - 800-824-6814

"MEDSTAR" on UHF 462.95 MHz PL 77


"MEDSTAR" on COG 800 MHz VA HOSP zone

"MEDSTAR" on UNICOM Air-to-Ground VHF 123.05

Self Announce on CTAF Air-to-Air VHF 123.025

- Approach/departure north over the golf course or south over the reservoir. Avoid over-flight of hospital and residential area to west.
- Upper helipad is for unloading of patients only (no parking or shutting down without coordination). Minimize waiting with engines running. Max weight limit 11,000 lbs. Max rotor diameter 70 feet.
- Lower helipad has 3 parking positions and is for heavier helicopters.

Advise "MedSTAR" Communications of intent to land and depart at least 5 minutes prior so that intake on hospital ventilation can be closed.

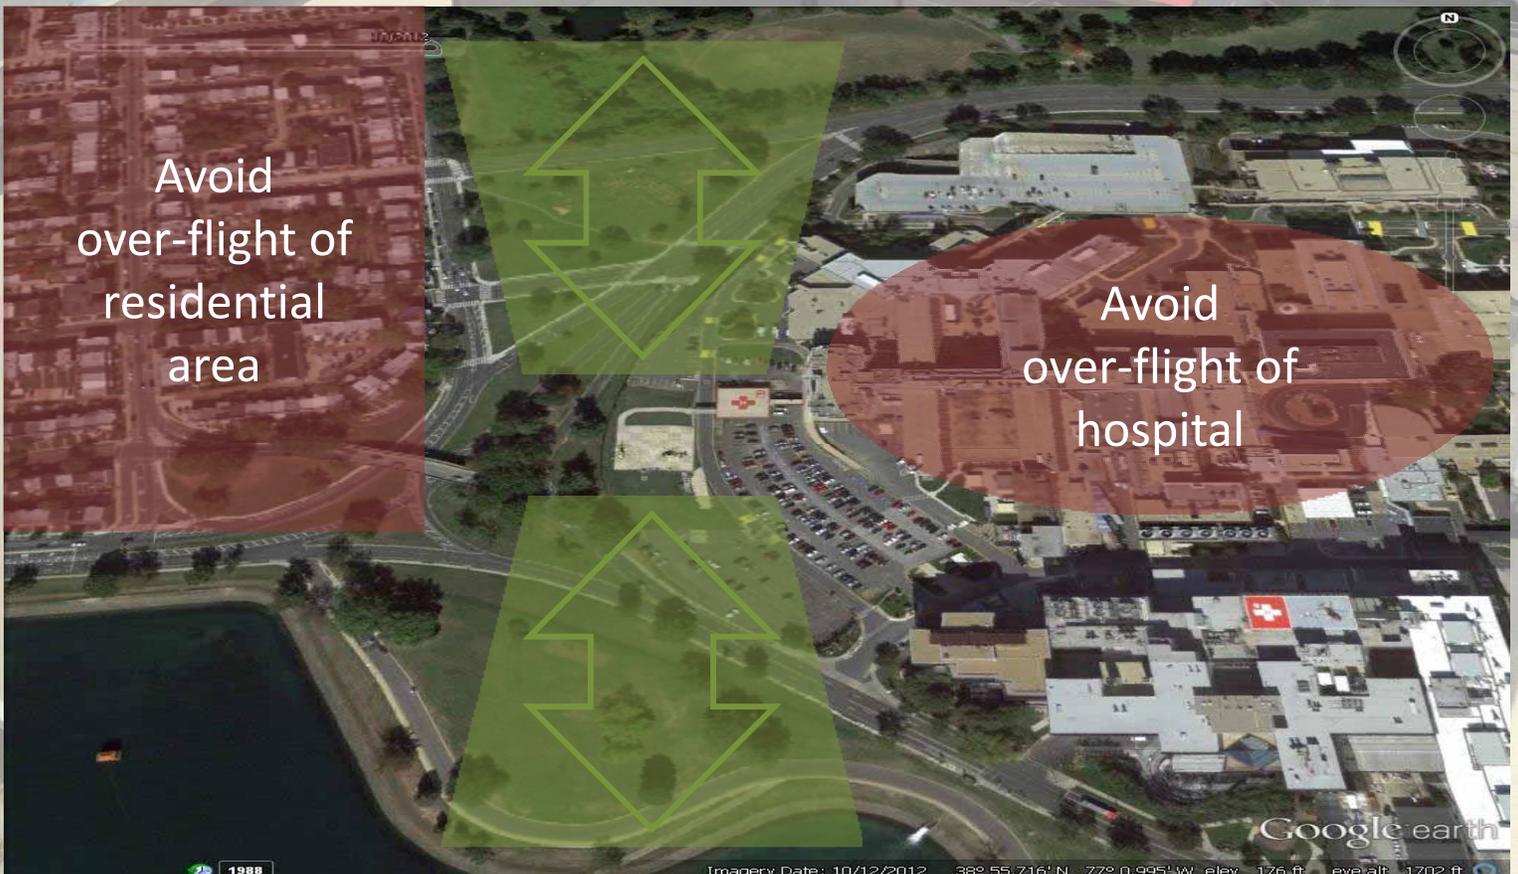

Revised: December 2013